

# In-Production Photo Report for

Monona Fire Department, WI


Job# 41523 : PWO# 32465567

---

Status as of March 20, 2026

In this report your commercial chassis began preparations for fire and emergency use, the pump house began the paint process, and the body remained staged. In the next report chassis prep may continue, the pump house may be painted then continue initial assembly, the body may begin initial assembly.



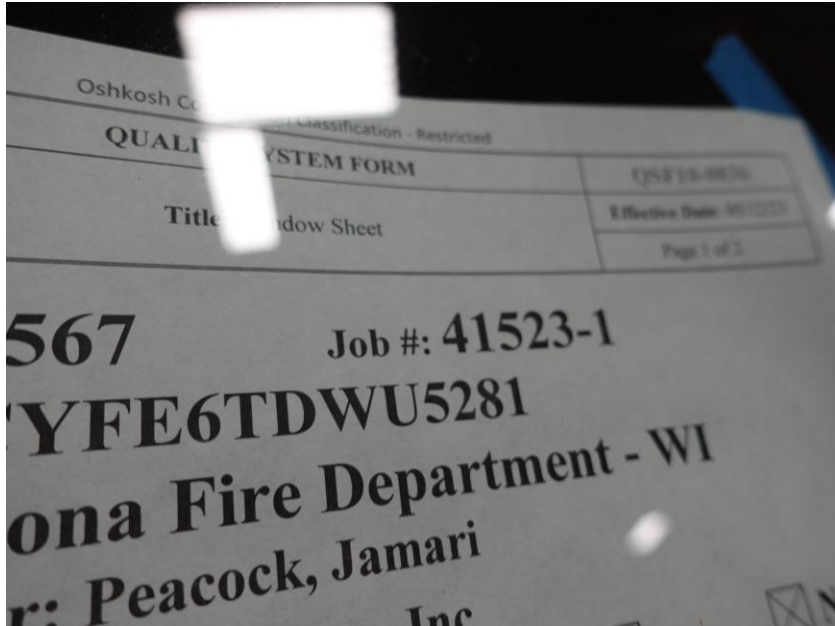

DSC07138




DSC07139



DSC07140



DSC07141

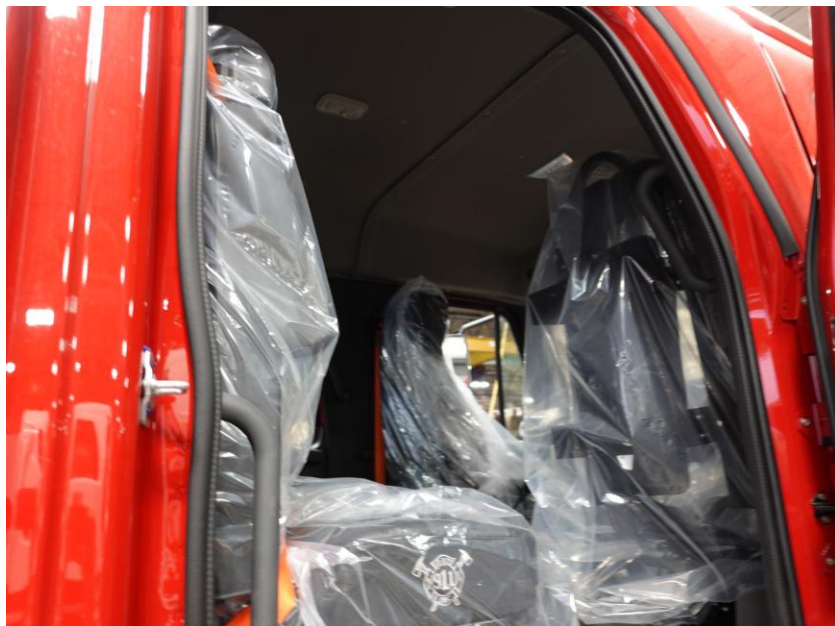

DSC07142




DSC07143



DSC07144



DSC07145

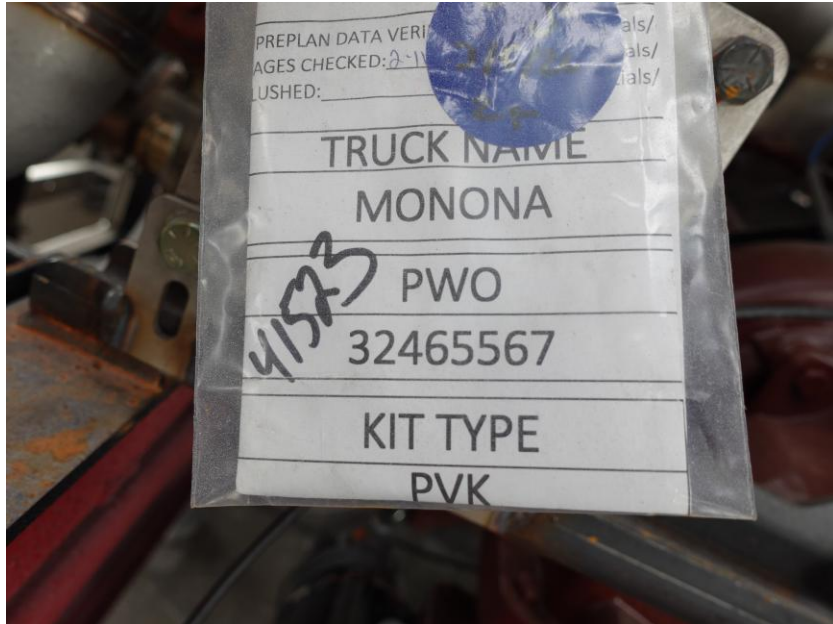


DSC07238




DSC07239



DSC07240

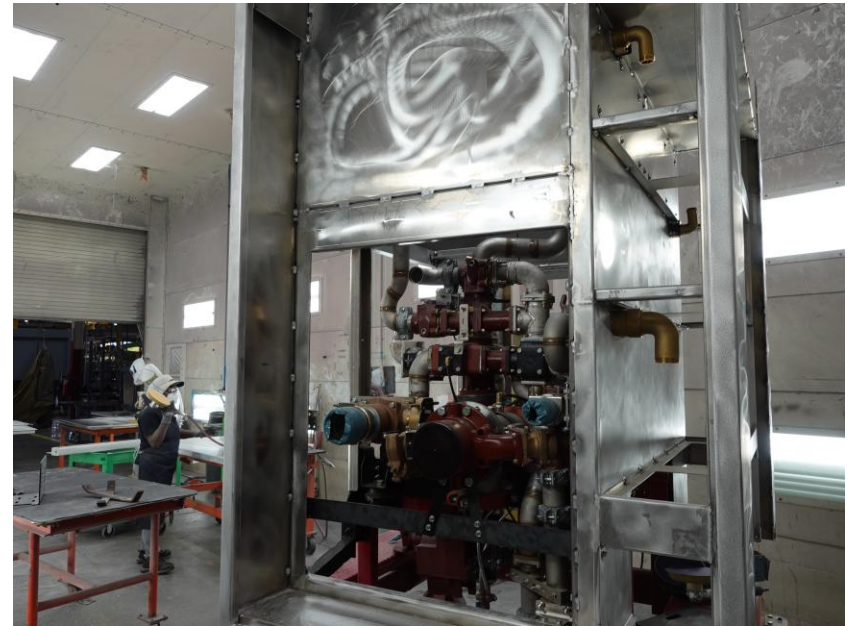

DSC07241

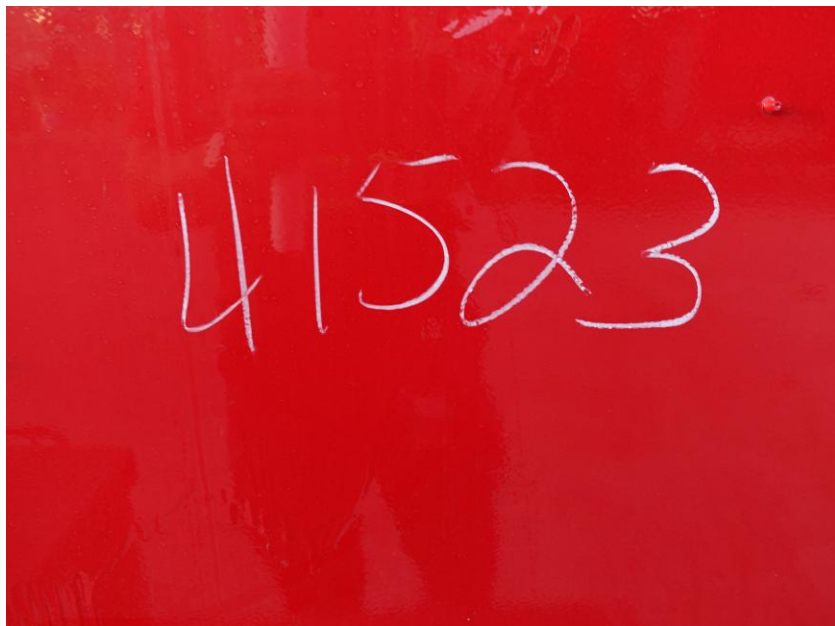

DSC07252



DSC07253



DSC07254



DSC07255



DSC07256



<https://reliantfire.com/>



An Oshkosh Corporation Company